




Classified by  
Underwriters Laboratories, Inc.  
to UL 1479 and CANULC S115



SYSTEM NO. C-AJ-1226

- Floor or Wall Assembly — Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified Concrete Blocks\*. Max diam of opening is 32 in.
- Metallic Sleeve — (Optional) Nom 32 in. diam (or smaller) Schedule 40 (or heavier) steel sleeve cast or grouted into floor or wall assembly, flush with floor or wall surfaces or extending a max of 3 in. above floor or beyond both surfaces of wall.
- Sheet Metal Sleeve — (Optional) Max 6 in. diam, min 26 ga galv steel provided with a 26 ga galv steel square flange spot welded to the sleeve at approx mid-height, or flush with bottom of sleeve in floors, and sized to be a min of 2 in. larger than the sleeve diam. The sleeve is to be cast in place and may extend a max of 4 in. below the bottom of the deck and a max of 1 in. above the top surface of the concrete floor.
- Sheet Metal Sleeve — (Optional) - Max 12 in. diam, min 24 ga galv steel provided with a 24 ga galv steel square flange spot welded to the sleeve at approx mid-height, or flush with bottom of sleeve in floors, and sized to be a min of 2 in. larger than the sleeve diam. The sleeve is to be cast in place and may extend a max of 4 in. below the bottom of the deck and a max of 1 in. above the top surface of the concrete floor.
- Through-Penetrant — One metallic pipe, tube or conduit to be installed either concentrically or eccentrically within the firestop system. The annular space between penetrant and periphery of opening shall be min 0 in. (point contact) to max 1-7/8 in. Penetrant may be installed with continuous point contact. Penetrant to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic penetrants may be used:
  - Steel Pipe — Nom 30 in. diam (or smaller) Schedule 10 (or heavier) steel pipe.
  - Iron Pipe — Nom 30 in. diam (or smaller) cast or ductile iron pipe.
  - Copper Pipe — Nom 6 in. diam (or smaller) Regular (or heavier) copper pipe.
  - Copper Tubing — Nom 6 in. diam (or smaller) Type L (or heavier) copper tubing.
  - Conduit — Nom 6 in. diam (or smaller) steel conduit.
  - Conduit — Nom 4 in. diam (or smaller) steel electrical metallic tubing (EMT).
- Firestop System — The firestop system shall consist of the following:
  - Packing Material — Min 4 in. thickness of min 4 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or sleeve or from both surfaces of wall or sleeve as required to accommodate the required thickness of fill material.
  - Fill, Void or Cavity Material\* — Sealant — Min 1/4 in. thickness of fill material applied within the annulus, flush with top surface of floor or sleeve or with both surfaces of wall or sleeve. At the point or continuous contact locations between penetrant and concrete or sleeve, a min 1/4 in. diam bead of fill material shall be applied at the concrete or sleeve/ pipe penetrant interface on the top surface of floor and on both surfaces of wall.


\*Bearing the UL Classification Mark



Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
June 27, 2007


## CONDUIT PENETRATION THROUGH RATED CONCRETE/ MASONRY WALL

SCALE: NONE



Classified by  
Underwriters Laboratories, Inc.  
to UL 1479 and CANULC S115

ANSI/UL1479 (ASTM E814)	CANULC S115
F Ratings —1 and 2 Hr (See Items 1 and 3)	F Ratings — 1 and 2 Hr (See Items 1 and 3)
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating at Ambient — Less Than 1 CFM/sq ft	FH Ratings —1 and 2 Hr (See Items 1 and 3)
L Rating at 400 F — Less Than 1 CFM/sq ft	FTH Rating — 0 Hr
	FTH Rating — 0 Hr
	L Rating at Ambient — Less Than 1 CFM/sq ft L Rating at 400 F — Less Than 1 CFM/sq ft



SYSTEM NO. W-L-1054

- Wall Assembly — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
  - Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC. When steel studs are used and the diam of opening exceeds the width of stud cavity, the opening shall be framed on all sides using lengths of steel stud installed between the vertical studs and screw-attached to the steel studs at each end. The framed opening in the wall shall be 4 to 6 in. wider and 4 to 6 in. higher than the diam of the penetrating item such that, when the penetrating item is installed in the opening, a 2 to 3 in. clearance is present between the penetrating item and the framing on all four sides.
  - Gypsum Board\* — 5/8 in. thick, 4 ft wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 32-1/4 in. for steel stud walls. Max diam of opening is 14-1/2 in. for wood stud walls.The F Rating of the firestop system is equal to the fire rating of the wall assembly.
- Through-Penetrants — One metallic pipe, conduit or tubing to be installed either concentrically or eccentrically within the firestop system. The annular space shall be min 0 in. to max 2-1/4 in. Pipe may be installed with continuous point contact. Pipe, conduit or tubing may be installed at an angle not greater than 45 degrees from perpendicular. Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
  - Steel Pipe — Nom 30 in. diam (or smaller) Schedule 10 (or heavier) steel pipe.
  - Iron Pipe — Nom 30 in. diam (or smaller) cast or ductile iron pipe.
  - Conduit — Nom 4 in. diam (or smaller) steel electrical metallic tubing or 6 in. diam steel conduit.
  - Copper Tubing — Nom 6 in. diam (or smaller) Type L (or heavier) copper tubing.
  - Copper Pipe — Nom 6 in. diam (or smaller) regular (or heavier) copper pipe.
- Fill, Void or Cavity Material\* — Sealant — Min 5/8 in. thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point or continuous contact locations between pipe and wall, a min 1/2 in. diam bead of fill material shall be applied at the pipe wall interface on both surfaces of wall.


HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-One Sealant

\*Bearing the UL Classification Mark



Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.  
November 26, 2012

## CONDUIT PENETRATION THROUGH RATED GYPSUM WALL




## LAY-IN LIGHTING FIXTURE SUPPORT DETAIL

SCALE: NONE


## RATED WALL SLEEVE DETAIL

SCALE: NONE




## SMOKE DAMPER DETAIL

SCALE: NONE

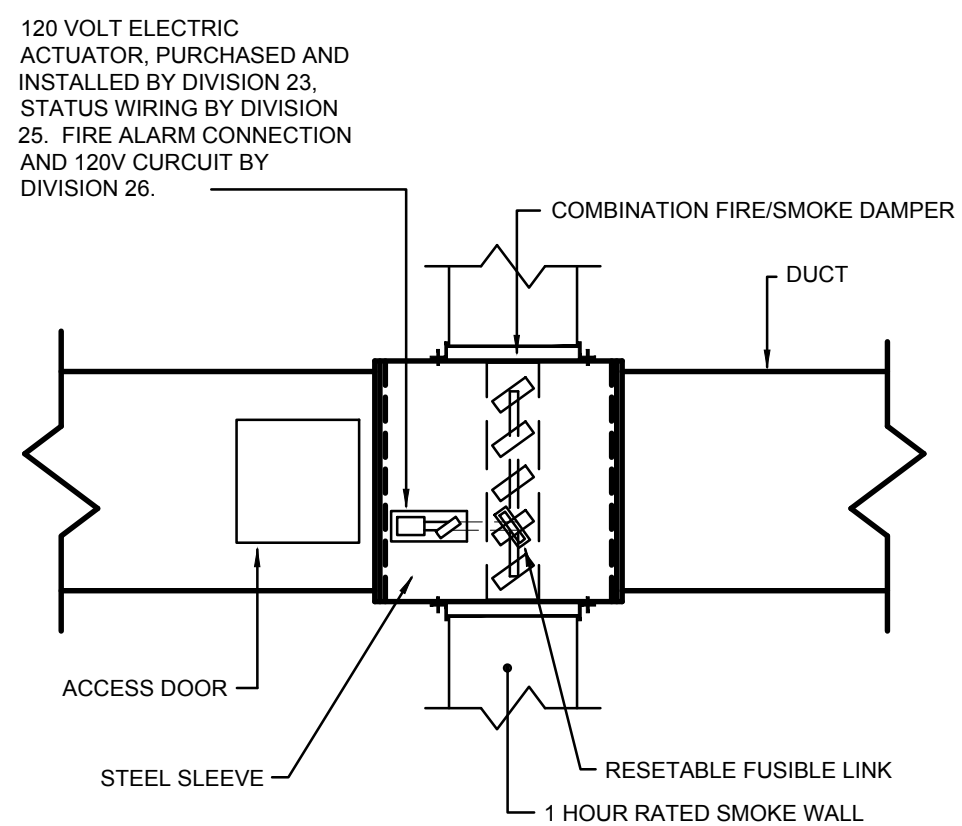

## FIRE/SMOKE DAMPER DETAIL

SCALE: NONE



## EXTERIOR 120V RECEPTACLE DETAIL

SCALE: NONE

Stephen Boruff, AIA  
Architects + Planners, Inc.  
AAC 002226

Architecture  
Planning  
Interior Architecture

901  
Northpoint Parkway  
Suite 101  
West Palm Beach  
Florida 33407

J L R D JOHNSON, LEVINSON  
BAGAN, DAVILA, INC.  
CONSULTANTS  
1450 Centrepark Boulevard, Suite 350  
West Palm Beach, Florida 33411  
(561) 888-2303 (561) 888-2302 Fax  
www.jlrdfirm.com

Robert Ortega Blanco, P.E. 90645  
Ward C. Connors, P.E. 45639

## New Kitchen Facility for



701 Boutwell Road  
Lake Worth, FL 33461



Project No. 22.046  
24 February 2023  
Bidding, Permit and  
Construction