




UPPER ATTACHMENT TO STRUCTURE

SCALE: NONE




REFRIG. PIPE RISER SUPPORT DETAIL

SCALE: NONE

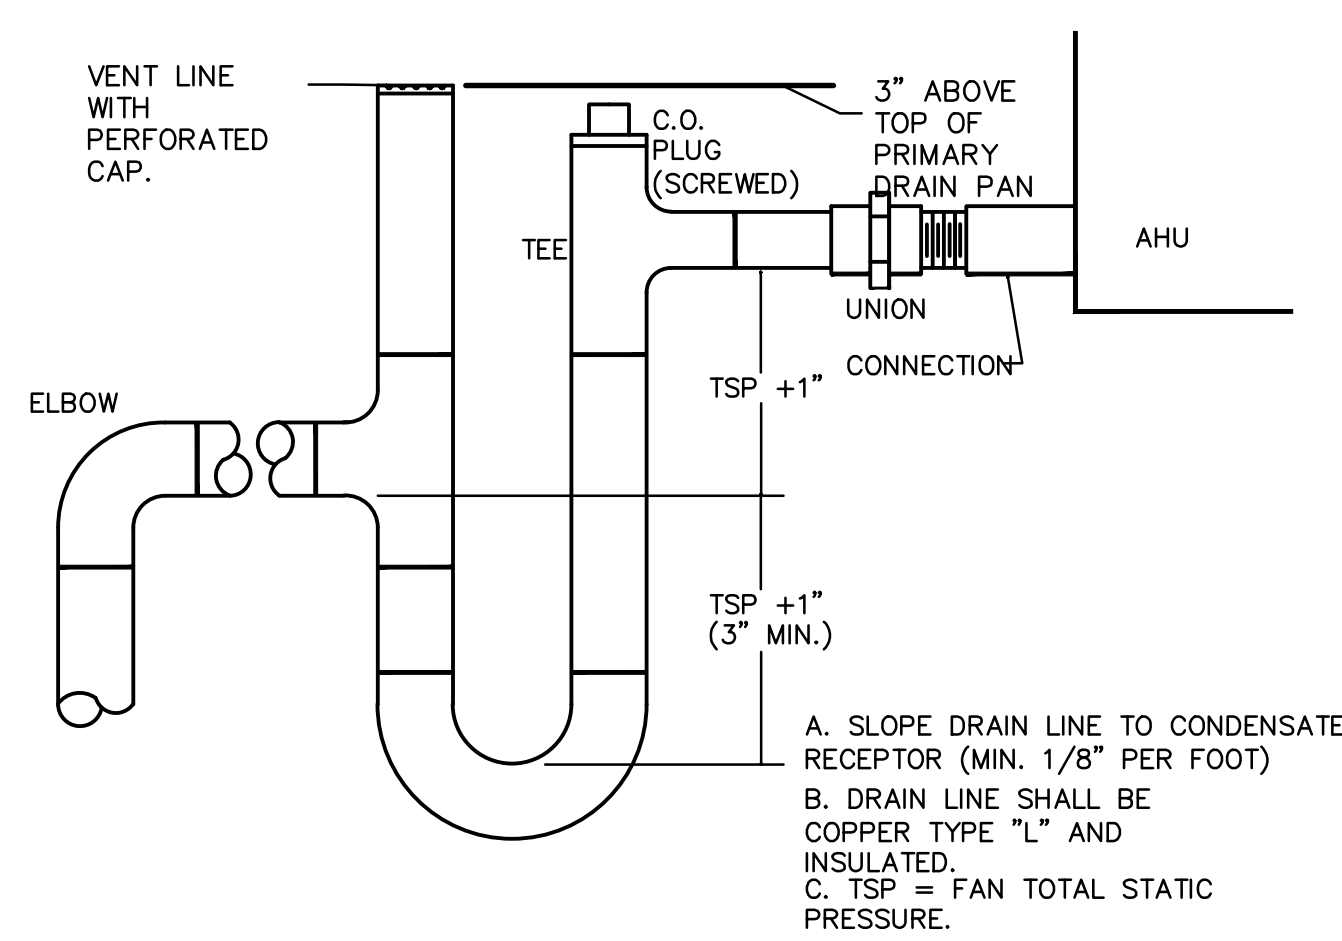


CONDENSATE DRAIN DETAIL

SCALE: NONE



FLOOR PENETRATION DETAIL

SCALE: NONE




FIRE DAMPER DETAIL

FLUSH MOUNTED GRILLE

SCALE: NONE

- (A) FIELD FABRICATED SLEEVE MAY BE PERMITTED. SUBMIT DETAIL FOR APPROVAL.
- (B) MANUFACTURER'S U.L. APPROVED INSTALLATION INSTRUCTIONS (CONFORMING TO U.L. 555 & NFPA 90A) GOVERN.




A.H.U. CONDENSATE DRAIN DETAIL

SCALE: NONE


AHU CONDENSATE DRAIN NOTES

- CONDENSATE PIPING SHALL BE SUPPORTED FROM ROOF AT 4'-0" (MIN) INTERVALS TO MAINTAIN 1/4" SLOPE. CONTRACTOR SHALL SUBMIT SHOP DRAWING TO ENGINEER FOR REVIEW OF CONDENSATE SUPPORT.
- CONDENSATE DRAIN SHALL BE PIPED FULL SIZE OF UNIT CONNECTION
- CONDENSATE PIPING SHALL BE INSULATED PER SPECIFICATIONS.



VAV TERMINAL BOX DETAIL

SCALE: NONE



ADJUSTABLE CONDENSING UNIT BASE DETAIL

NOTES: FASTENING OF HURRICANE STRAP TO UNIT WITH TEK SCREWS WILL VOID MANUFACTURES WARRANTY AND IS NOT PERMITTED IN THIS APPLICATION.

SCALE: NONE


Stephen Boruff, AIA
Architects + Planners, Inc.
AAC OO2226
Architecture
Planning
Interior Architecture

901
Northpoint Parkway
Suite 101
West Palm Beach
Florida 33407

J L JOHNSON, LEVINSON
R D BAKAL, DAVILA, INC.
CONSULTANTS
1450 Centrepark Boulevard, Suite 350
West Palm Beach, Florida 33411
(561) 688-2303 (561) 688-2302 Fax
www.jlrdinc.com

Ruben Ortega Blanco, P.E. 90645
Ward C. Connors, P.E. 45839

New Kitchen
Facility for



701 Boutwell Road
Lake Worth, FL 33461



Project No. 22.046
24 February 2023
Bidding, Permit and
Construction