

THIS DOCUMENT IS THE PROPERTY OF CURRIE SOWARDS AGUILA ARCHITECTS INC.. ALL RIGHTS ARE RESERVED. ANY POSSESSION, REPRODUCTION OR OTHER USE OF THIS DOCUMENT, WITHOUT THE WRITTEN CONSENT OF CURRIE SOWARDS AGUILA ARCHITECTS INC., IS PROHIBITED.

SLOPE OF HORIZ. DRAINAGE PIPE	
SIZE (inches)	MINIMUM SLOPE (inch per foot)
2-1/2 or less	1/4
3 to 6	1/8
8 or larger	1/16

TABLE 704.1 OF THE FLORIDA PLUMBING CODE 2020


## SHOCK ARRESTOR SCHEDULE

P.D.I. DESIGNATION	MANUF. & MODEL	FIXTURE UNITS	CONNECTION
A	SIoux CHIEF 652-A	1-11	1/2"
B	SIoux CHIEF 653-B	12-32	3/4"
C	SIoux CHIEF 654-C	33-60	1"


SIoux CHIEF SHOCK ARRESTORS APPROVED FOR INSTALLATION WITH NO ACCESS DOOR REQUIRED. CONFORMS TO ANSI/ASSE 1010 STANDARDS.

TYPICAL PLUMBING FIXTURE CONNECTION SCHEDULE							
TYPE	SOIL / WASTE	VENT	TRAP	CW	HW	REMARKS	
2" HUB DRAIN	2"	2"	2"	-	-	PROVIDE 1/2" CW TRAP PRIMER CONNECTION.	
3" HUB DRAIN	3"	2"	3"	-	-	PROVIDE 1/2" CW TRAP PRIMER CONNECTION.	
COFFEE MAKER/WATER FILTER	-	-	-	1/2"	-	PROVIDE WITH VACUUM BREAKER.	
DISHWASHER (RESIDENTIAL TYPE)	1"	-	-	-	1/2"	CONNECT WASTE TO KITCHEN SINK TAILPIECE. PROVIDE WITH VACUUM BREAKER.	
ELECTRIC WATER COOLER	2"	2"	1 1/4"	1/2"	-	-	
OUTLET BOX	-	-	-	1/2"	-	PROVIDE w/ INTEGRAL WATER HAMMER ARRESTOR.	
WASHING MACHINE OUTLET BOX	3"	2"	2"	1/2"	1/2"	PROVIDE w/ INTEGRAL WATER HAMMER ARRESTORS.	
SINK	2"	2"	1 1/2"	1/2"	1/2"	1.0 GPM AT 60 PSI MAXIMUM.	
MOP SINK	3"	2"	3"	1/2"	1/2"	PROVIDE HOSE THREAD FAUCET WITH INTEGRAL VACUUM BREAKER.	
LAVATORY (PUBLIC)	2"	2"	1 1/4"	1/2"	1/2"	0.5 GPM AT 60 PSI MAXIMUM. (0.25 GALLON METERING CYCLE)	
REFRIGERATOR	-	-	-	1/2"	-	PROVIDE WITH VACUUM BREAKER.	
WATER CLOSET (FLUSH VALVE)	3"	2"	INTEGRAL	1"	-	1.28 GALLONS PER FLUSHING CYCLE MAXIMUM.	
WATER CLOSET (FLUSH TANK)	3"	2"	INTEGRAL	1/2"	-	1.28 GALLONS PER FLUSHING CYCLE MAXIMUM.	
URINAL	2"	2"	INTEGRAL	3/4"	-	0.128 GALLONS PER FLUSHING CYCLE MAXIMUM.	

NOTE: PLUMBING FIXTURE CONNECTION SCHEDULE IS SHOWN FOR CONVENIENCE ONLY. PLUMBING CONTRACTOR TO CONFIRM FINAL PLUMBING FIXTURE CONNECTION SIZES WITH PLUMBING FIXTURE MANUFACTURER'S REQUIREMENTS. ALL FIXTURES SHALL COMPLY WITH REQUIREMENTS OF LOCAL WATER-USE EFFICIENCY ORDINANCES.




PLUMBING LEGEND		
CO	CLEAN OUT	— — — — — SANITARY SEWER PIPING
FD	FLOOR DRAIN	— — — — — VENT PIPING
CW	DOMESTIC COLD WATER	— — — — — DOMESTIC COLD WATER PIPING
HW	DOMESTIC HOT WATER	— — — — — HOT WATER PIPING (110°)
VTR	VENT THRU ROOF	— CD — CONDENSATE PIPING
CA	GATE VALVE	— CA — COMPRESSED AIR PIPING
WHA	WATER HAMMER ARRESTER (PDI No.)	— O — PIPE RISE UP
FD	FLOOR DRAIN	— D — PIPE DOWN OR DROP
P-TRAP	P-TRAP	— E — CAPPED END OF PIPE
		— C — POINT OF CONNECTION



## PLATFORM MOUNTED WATER HEATER DETAIL

NOT TO SCALE



## TEMPERED AND COLD WATER SUPPLY CONNECTIONS FOR PUBLIC LAVATORIES

NOT TO SCALE

## PLUMBING SHEET INDEX

SHEET#	DESCRIPTION
P0.1	PLUMBING NOTES, LEGENDS, AND DETAILS
P2.1	SANITARY PLAN
P3.1	DOMESTIC WATER PLAN
P5.1	PLUMBING ISOMETRICS

## PLUMBING FIXTURE SCHEDULE

L1	HANDICAP LAVATORY, AMERICAN STANDARD "DECLYN" Q321.026 WALL MOUNT WHITE VITREOUS CHINA WITH T&S BRASS MODEL #B-2711-VF05, 0.5 GPM, SINGLE-LEVER, MANUALLY-OPERATED CENTERSET FAUCET. PROVIDE WITH MIFAB SERIES MC-41 CONCEALED-ARM CARRIER AND PLUMBEREX PRO EXTREME UNDER LAV SUPPLY & TRAP PROTECTORS.
WC1	HANDICAP WATER CLOSET, AMERICAN STANDARD "CADET RIGHT HEIGHT" MODEL #2467.016, 1.28 GPF, TWO-PIECE, FLOOR MOUNTED, WHITE VITREOUS CHINA WITH ELONGATED BOWL. PROVIDE WITH TRIP LEVER TO WIDE SIDE OF ROOM AND AMERICAN STANDARD MODEL #5311.012 ELONGATED SEAT, OPEN FRONT LESS COVER.
U1	HANDICAP URINAL, AMERICAN STANDARD MODEL #WASHBROOK 6590.001-0.125, WALL-MOUNT, TOP-SPUD, BATTERY-POWERED, SENSOR-ACTUATED FLUSH VALVE SLOAN MODEL #B186-0.125 GPF. PROVIDE WITH MIFAB SERIES MC-32 DOUBLE-PLATE CARRIER.
U2	URINAL, AMERICAN STANDARD MODEL #WASHBROOK 6590.001-0.125, WALL-MOUNT, TOP-SPUD, BATTERY-POWERED, SENSOR-ACTUATED FLUSH VALVE SLOAN MODEL #B186-0.125 GPF. PROVIDE WITH MIFAB SERIES MC-32 DOUBLE-PLATE CARRIER.
SH1	HANDICAP SHOWER, BARRIER-FREE ENCLOSURE BY ARCHITECT. PROVIDE WITH ZURN MODEL #27301-SS-MT-DV-2P-HW-H9-S9 SHOWER UNIT, PRESSURE-BALANCE MIXING VALVE, CERAMIC DISC, FIXED & HAND HELD WITH SPEAKMAN S-3010 1.5 GPM SHOWER HEAD, ARM S-2540 SINGLE LEVER CONTROL. DRAIN MIFAB #F1000-C.
MSK1	MOP SINK, FIAT MODEL #MSB-2424 WITH PLAIN PLAINS, TERRAZZO WITH CERAMIC GUARDS & WALL GUARDS. PROVIDE WITH FIAT FACUET MODEL #B30-AA, CHROME WITH CERAMIC-DISC CARTRIDGES & INTEGRAL LOOSE KEY STOPS.
SK1	BREAK ROOM SINK, JUST MODEL #SL-ADA-2122-A-GR, ADA-COMPLIANT, 6-1/2" DEEP SINGLE-BASIN, LEDGE-BACK, SELF-RIMMING, 18-GAUGE TYPE 304 STAINLESS STEEL, WITH GRID STRAINER AND T&S BRASS FAUCET MODEL #B-2730-WS, 5-3/4" SWIVEL SPOUT, 1.5 GPM AERATOR, AND CERAMIC DISC CARTRIDGES.
EW1	ELECTRIC WATER HEATER, LOCHINVAR MODEL #EST050KD, 50 GAL. 208V/1PH/6 kW. SET UNIT ON A STAND AND PROVIDE WITH RECIRCULATION PUMP - BELL & GOSSET MODEL #PL-30B AND THERMAL EXPANSION TANK - AMTROL MODEL #S1-12.
FD1	FLOOR DRAIN, MIFAB MODEL #F1100-C w/ 6" ROUND STAINLESS STEEL STRAINER.
FD2	FLOOR DRAIN, MIFAB MODEL #F1100-EF-3-7-C w/ 6" ROUND STAINLESS STEEL STRAINER & FUNNEL.
OB1	WATER OUTLET BOX, GUY GRAY MODEL #BIM875QTSAB WITH LEAD-FREE QUARTER-TURN VALVE & INTEGRAL WATER-HAMMER ARRESTOR.
WCO	WALL CLEANOUT, MIFAB C1430-RD WITH BRONZE PLUG, STAINLESS STEEL COVER, AND SCREW.

GENERAL NOTES:


(1) - FIXTURES SHALL BE AS SHOWN OR EQUAL.

(2) - ALL FIXTURES SHALL COMPLY WITH TABLE 604.4 OF FBC 2020


(3) - ALL FIXTURE TRIM PACKAGES INCLUDING BUT NOT LIMITED TO TRAP, ANGLE STOP, FLUSH VALVE, SUPPLY TUBES, AND CLEANOUT COVER PLATES SHALL BE OF THE SAME FINISH AS THE ABOVE SPECIFIED FAUCET AND PER ARCHITECTURAL FINISH SCHEDULE.

(4) - ALL FIXTURES SHALL BE ROUGHED IN PER MANUFACTURER CUT SHEET TO MAINTAIN UNIFORMITY.

NOTE: FINAL FIXTURE, FAUCET, AND TRIM SELECTIONS SHALL BE REVIEWED AND APPROVED BY ARCHITECT AND OWNER PRIOR TO SUBMITTAL TO ENGINEER OF RECORD.



## WALL CLEANOUT DETAIL

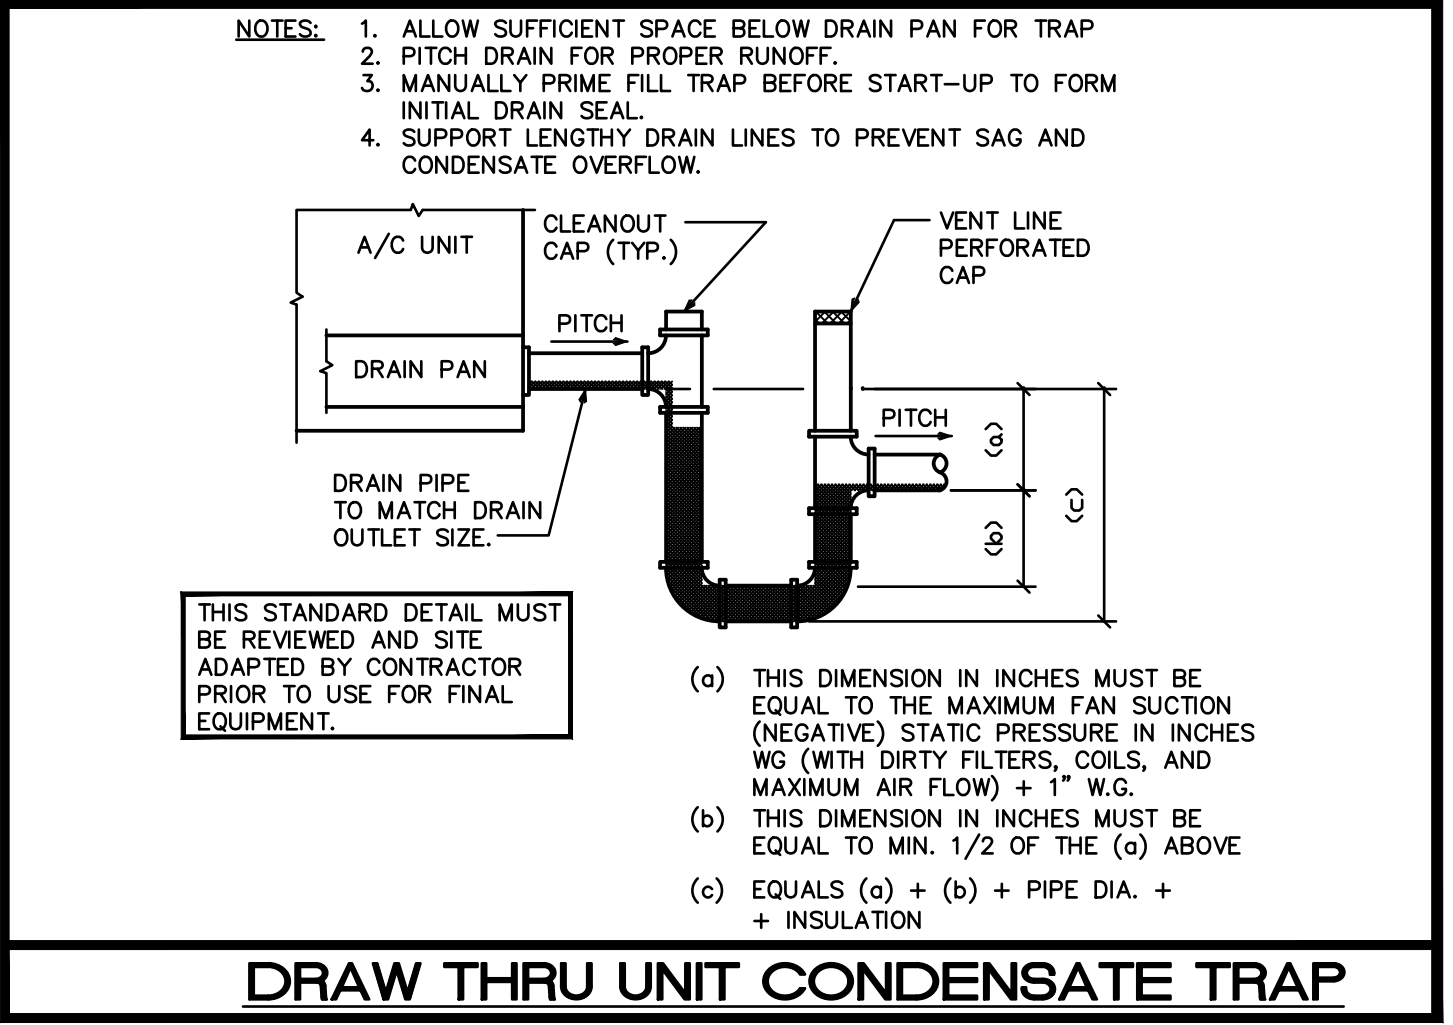


## DRAW THRU UNIT CONDENSATE TRAP

## PLUMBING NOTES

- THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, AND EQUIPMENT NECESSARY FOR THE INSTALLATION OF A COMPLETE SCOPE OF WORK. ALL WORKMANSHIP AND MATERIALS SHALL BE IN STRICT ACCORDANCE WITH THE FLORIDA BUILDING CODE 7th EDITION (2020) - PLUMBING, APPLICABLE LOCAL CODES, RULES, AND ORDINANCES.
- THE PLUMBING CONTRACTOR SHALL VISIT THE JOB SITE AND BECOME THOROUGHLY FAMILIAR WITH ALL EXISTING CONDITIONS.
- ALL MATERIALS SHALL BE NEW AND OF GOOD QUALITY.
- ALL WORK SHALL BE PERFORMED BY A LICENSED PLUMBING CONTRACTOR IN A FIRST CLASS WORKMANLIKE MANNER. THE COMPLETED SYSTEM SHALL BE FULLY-OPERATIONAL. ALL EXCAVATION AND BACKFILL AS REQUIRED FOR THIS PHASE OF CONSTRUCTION SHALL BE A PART OF THIS CONTRACT.
- REQUIRED INSURANCE SHALL BE PROVIDED BY THE PLUMBING CONTRACTOR FOR PROTECTION AGAINST PUBLIC LIABILITY AND PROPERTY DAMAGE FOR THE DURATION OF THE WORK.
- PLUMBING CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS, FEES, INSPECTIONS AND TESTS. PLUMBING CONTRACTOR SHALL OBTAIN PERMIT AND APPROVED SUBMITTALS PRIOR TO BEGINNING WORK OR ORDERING EQUIPMENT. PLUMBING CONTRACTOR MUST BE PRESENT FOR ALL INSPECTIONS OF HIS WORK BY REGULATORY AUTHORITIES.
- CONTRACTOR SHALL SUBMIT TO ARCHITECT/ENGINEER, FOR REVIEW & APPROVAL, FIVE (5) SETS OF MANUFACTURER'S CUT SHEETS FOR EACH FIXTURE, PIPING/FITTING MATERIAL AND EQUIPMENT ITEM WITH ASSOCIATED CONTROLS, THAT ARE INCLUDED IN THE CONTRACT.
- DRAWINGS ARE DIAGRAMMATIC. DO NOT SCALE FOR THE EXACT LOCATION OF FIXTURES, PIPING, EQUIPMENT, ETC.
- ALL WORK SHALL BE COORDINATED WITH OTHER TRADES TO AVOID INTERFERENCE WITH THE PROGRESS OF CONSTRUCTION. REPORT ANY DISCREPANCY TO ARCHITECT/ENGINEER PRIOR TO BEGINNING CONSTRUCTION.
- VERIFY LOCATION, SIZE, DIRECTION OF FLOW AND INVERT ELEVATIONS OF ALL EXISTING UTILITIES PRIOR TO BEGINNING OF CONSTRUCTION. ADVISE ARCHITECT/ENGINEER OF ANY DISCREPANCIES.
- WATER DISTRIBUTION PIPING ABOVE AND BELOW GROUND SHALL BE TYPE "L" COPPER. ALTERNATE PIPING & FITTINGS MATERIALS MAY BE USED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) - PLUMBING, TABLES 605.3, 605.4 & 605.5, WHEN APPROVED BY ENGINEER OF RECORD AND LOCAL AUTHORITY HAVING JURISDICTION. PROVIDE ALTERNATE FOR CPVC PIPING & FITTINGS EQUAL TO LUBRIZOL CORZAN OR FLOW-GUARD GOLD. PROVIDE ALTERNATE FOR PEX TYPE 'A' PIPING & FITTINGS EQUAL TO UPONOR. ALTERNATES ARE PERTINENT FOR WATER SERVICES KNOWN OR DETERMINED TO HAVE ACIDIC CHARACTERISTICS OR OTHER PARTICULAR CIRCUMSTANCES AS DEEMED APPROPRIATE BY DIRECTIVE FROM THE OWNER. CONTRACTOR SHALL PERFORM A WATER TEST TO DETERMINE WATER CHEMISTRY PRIOR TO ANY WORK OR PIPING INSTALLATION AND SHALL SUBMIT TEST RESULTS TO THE ARCHITECT/ENGINEER FOR REVIEW AND APPROVAL. DISINFECTION OF POTABLE WATER SYSTEM SHALL COMPLY WITH FLORIDA BUILDING CODE 7th EDITION (2020) - PLUMBING, SECTION 610. ALL WATER PIPING & FITTINGS SHALL BE OF DOMESTIC MANUFACTURE; SPECIFICALLY IN THE UNITED STATES OF AMERICA.
- SOIL, WASTE, VENT, AND RAINWATER (DWV) PIPING & FITTINGS SHALL BE CAST IRON OR PVC, WHERE CODE ALLOWS. PVC SHALL NOT BE USED IN PLENUMS. PVC PIPING SHALL BE SOLID-CORE ONLY. FOAM-CORE PIPING SHALL NOT BE ACCEPTED. CAST IRON PIPING & FITTINGS SHALL BEAR THE CISP-301 MARK. ALL DWV PIPING & FITTINGS SHALL BE OF DOMESTIC MANUFACTURE; SPECIFICALLY IN THE UNITED STATES OF AMERICA. ALL HORIZONTAL SANITARY PIPING RUN ABOVE FINISHED FLOOR THAT RECEIVES COLD DRAINAGE FROM REFRIGERATION EQUIPMENT SHALL BE INSULATED WITH ARMAFLEX AND A VAPOR-BARRIER JACKET.
- NATURAL & PROPANE FUEL GAS PIPING SHALL BE THE FOLLOWING: UNDERGROUND - PE PIPE COMPLYING WITH ASTM D2583 OR ASTM D3281 AND ASTM D2581 AND ASTM D3281. ABOVEGROUND - SCHEDULE 40 BLACK STEEL COMPLYING WITH ASTM A53 AND THREADED, WELDED, OR FLANGED FITTINGS. CORRUGATED STAINLESS STEEL TUBING COMPLYING WITH ANSI/AS LCI SHALL BE ALLOWED ONLY WITHIN INTERIOR ACCESSIBLE SPACES.
- COMPRESSED AIR PIPING SHALL BE ASTM B241 EXTRUDED ALUMINUM ALLOY COMPLIANT WITH ASME B31.1 OR GALVANIZED BLACK STEEL IN ACCORDANCE WITH DIN EN 10255. ALUMINUM PIPING AND MECHANICAL GROOVED-JOINT FITTINGS SHALL BE AIRNET, TRANSAIR, OR APPROVED EQUAL. STEEL PIPING AND MECHANICAL GROOVED-JOINT FITTINGS SHALL BE VIEGA MEGAPRESS OR APPROVED EQUAL.
- ALL FIXTURES MUST BE PROVIDED WITH READILY ACCESSIBLE ANGLE STOPS AND APPROPRIATELY MARKED ACCESS PANELS (WHERE REQUIRED). COORDINATE LOCATIONS WITH GENERAL CONTRACTOR PRIOR TO INSTALLATION.
- PROVIDE APPROVED WATER HAMMER ARRESTORS FOR ALL (GROUP) PLUMBING FIXTURES, SIZED & LOCATED PER MANUFACTURER'S INSTALLATION INSTRUCTIONS & PDI-WH201.
- PROVIDE DIELECTRIC COUPLINGS OR FLANGES BETWEEN ALL DISSIMILAR METALS IN PIPING AND EQUIPMENT CONNECTIONS.
- ISOLATE COPPER PIPING FROM METALLIC HANGERS OR SUPPORTS WITH ISOLATOR PADS OR NON-CONDUCTIVE MATERIAL.
- ALL FIRE RATED FLOOR AND WALL PENETRATIONS SHALL BE PROPERLY PROTECTED FROM FIRE, SMOKE AND WATER PENETRATION BY FILLING ANNULAR SPACE BETWEEN PIPING AND SLEEVES WITH INTUMESCENT CAULK, TO ACHIEVE THE SAME RATINGS AS FLOORS OR FLOORS, AS PART OF THE PLUMBING CONTRACTOR'S WORK.
- PLUMBING CONTRACTOR SHALL GUARANTEE ALL MATERIALS AND WORKMANSHIP FREE FROM DEFECTS FOR A PERIOD OF NOT LESS THAN ONE (1) YEAR FROM DATE OF ACCEPTANCE BY OWNER. CORRECTION OF ANY DEFECTS SHALL BE COMPLETED WITHOUT ADDITIONAL CHARGE AND SHALL INCLUDE REPLACEMENT OR REPAIR OF ANY OTHER PHASE OF THE INSTALLATION WHICH MAY HAVE BEEN DAMAGED.
- PROVIDE ACCESS PANELS FOR ALL CONCEALED VALVES. ACCESS PANELS IN RATED WALLS SHALL MAINTAIN THE SAME RATING AND SHALL MATCH THE FINISH OF THE WALL IN WHICH IT IS INSTALLED.
- PROVIDE COMBINATION CLEANOUT PLUG AND COVER PLATE OR ACCESS PANEL FOR ALL WALL CLEANOUTS. FINISH TO MATCH NEARBY FIXTURE TRIM.
- NO COMBUSTIBLE MATERIAL SHALL BE INSTALLED IN MECHANICAL ROOMS NOR IN CEILING SPACES WHERE USED AS RETURN AIR PLENUMS.
- NO WATER, SANITARY OR DRAINAGE PIPING SHALL BE INSTALLED IN ELECTRICAL OR ELEVATOR EQUIPMENT ROOMS.
- ALL CONTROL VALVES SHALL BE TAGGED AND MARKED. A REPRODUCIBLE DIAGRAM LOCATING ALL VALVES SHALL BE FURNISHED FOR OWNER/OPERATOR.
- CONDENSATE DRAIN PIPING SHALL BE TYPE "L" COPPER WITH ARMAFLEX INSULATION AND A VAPOR-BARRIER JACKET PER FLORIDA BUILDING CODE 7th EDITION (2020) - ENERGY CONSERVATION, TABLE C403.2.8. PVC WITHOUT INSULATION IS ACCEPTABLE FOR RISERS AND BELOW GRADE PIPING WHEN USED IN A RETURN AIR PLENUM. CPVC PIPING WITH INSULATION IS ACCEPTABLE IN LOCATIONS WHERE ALLOWED BY LOCAL CODES. CONDENSATE PIPING SHALL NOT DRAIN ONTO THE ROOFING SYSTEM NOR ANY OF ITS COMPONENTS. CONDENSATE PIPING ARRANGEMENT IS EXEMPT FROM MINIMUM EQUIPMENT CLEARANCE REQUIREMENTS PER FLORIDA BUILDING CODE 7th EDITION (2020), SECTION 1522.3.5. ALL HORIZONTAL RAINWATER PIPING RUN ABOVE FINISHED FLOOR THAT RECEIVES CONDENSATE DISCHARGE SHALL BE INSULATED WITH ARMAFLEX AND A VAPOR-BARRIER JACKET.
- HOT WATER PIPING INSULATION SHALL BE PROVIDED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) - PLUMBING, SECTION 607.5 & FLORIDA BUILDING CODE 7th EDITION (2020) - ENERGY CONSERVATION, TABLE C403.2.10. CONTRACTOR SHALL USE ARMAFLEX OR EQUAL WHERE APPLICABLE. WHERE DOMESTIC WATER TEMPERATURES CAN CAUSE SWEATING, ALL COLD WATER PIPING SHALL BE INSULATED WITH ARMAFLEX INSULATION AND A VAPOR-BARRIER JACKET, PER FLORIDA BUILDING CODE 7th EDITION (2020) - ENERGY CONSERVATION, TABLE C403.2.10.
- AIR ADMITTANCE VALVES MAY BE USED AS AN ALTERNATE TO VENT PIPING THRU ROOF WHERE ACCEPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION. INSTALLATION METHODS SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND REQUIREMENTS.

ISSUED FOR PERMIT	-
ISSUED FOR CONSTRUCTION	-
KAMM CONSULTING PROJECT #:	2023-0419
PROJECT MANAGER:	RON SLOAN
<b>KAMM Consulting</b>	
1407 West Newport Center Drive Deerfield Beach, Florida 33442 Phone 954.949.2200 Fax 954.949.2201 engineering@kammconsulting.com Certification of Authorization 081189	date signature



**CURRIE  
SOWARDS  
AGUILA  
architects**

Architecture, Planning,  
Interiors, &  
Sustainable Design

AA26001584

185 NE 4TH AVENUE, SUITE 101  
DELRAY BEACH, FL 33483

T: (561) 276-4951 F: (561) 243-8184

E-MAIL: office@csa-architects.com

ISSUED FOR :

BIDS

PERMIT

CONSTRUCTION

SEAL

JOSE AGUILA  
FL. REG# A000

PROJECT TITLE

**STONEBRIDGE  
COUNTRY CLUB  
GOLF  
MAINTENANCE  
BUILDING**

17501 S. STATE ROAD 7  
BOCA RATON, FL 33498

REVISIONS

THESE DRAWINGS ARE PREPARED PER ESTABLISHED INDUSTRY STANDARDS AND REPRESENT THE ARCHITECT AND ENGINEERS DESIGN CONCEPT. THEY ARE NOT INTENDED TO PROVIDE EVERY DETAIL OR CONDITION REQUIRED TO CONSTRUCT THE BUILDING. THE CONTRACTOR THROUGH SUBMITTALS AND OTHER COORDINATION EFFORTS IS FULLY RESPONSIBLE FOR PROVIDING A COMPLETE AND OPERATIONAL BUILDING WHETHER INDICATED ON THE PLANS OR NOT.

DRAWING TITLE  
PLUMBING NOTES

DATE  
09/08/23

JOB NUMBER  
220906

DRAWING NUMBER

**P0.1**

PERMIT SET - 10/16/23